GENERAL NOTES:

1. FOR LEGEND AND SCHEDULES, SEE DRAWING E0.0; FOR PANEL SCHEDULES, SEE DRAWINGS E6.0 AND E6.1.
2. CONTRACTOR SHALL PROVIDE BRANCH CIRCUIT WIRING TO ALL ITEMS WHICH REQUIRE ELECTRICAL CONNECTIONS. WHERE BRANCH CIRCUIT WIRING IS NOT SHOWN, CONTRACTOR SHALL CONNECT ITEMS TO THE CIRCUITS INDICATED. EXACT ROUTING OF CONDUITS AND WIRING SHALL BE DETERMINED BY THE CONTRACTOR IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND SPECIFICATIONS.
3. CONTRACTOR SHALL USE ONLY THOSE WIRING METHODS ALLOW IN THE SPECIFICATIONS.
4. A MAXIMUM OF 3 CIRCUITS SHALL BE RUN IN ONE CONDUIT, CIRCUITS MUST BE ON SEPARATE PHASES. CIRCUITS SHALL NOT SHARE A COMMON NEUTRAL.
5. MINIMUM WIRE SIZE SHALL BE #12AWG. MINIMUM CONDUIT SIZE SHALL BE 3/4".
6. THE ELECTRICAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND CONDITIONS AT THE SITE.
7. ALLOW CLEAR SPACE IN FRONT OF ALL PANELBOARDS, SWITCHBOARDS, ELECTRICAL EQUIPMENT, ETC., AS REQUIRED BY NEC.
8. ALL RECEPTACLE/DATA/PHONE DEVICE LOCATIONS TO BE COORDINATED WITH FURNITURE PLAN AND OWNER PRIOR TO ROUGH-IN. ALL DATA JACKS TO BE IMMEDIATELY ADJACENT TO RECEPTACLES.
9. PROVIDE CONDUIT, WIRING AND CONNECTIONS AS REQUIRED BY EQUIPMENT MANUFACTURER.
10. ALL RECEPTACLES CIRCUITS SHALL BE INSTALLED WITH FULL SIZE GROUND WIRE BACK TO PANEL.
11. INSTALL 1" CONDUIT FROM EACH TELEPHONE OUTLET TO CEILING PLENUM AND TERMINATE WITH BUSHING.

NOTES BY SYMBOL: (#)

(THIS DRAWING ONLY)

(1) MECHANICAL CONTRACTOR TO SUPPLY DISCONNECT SWITCH.

(2) JUNCTION BOX FOR DISH POWER ON ROOF. VERIFY EXACT LOCATION IN FIELD. ALSO, PROVIDE 1-1/2"C. TO TOTE ROOM WITH PULL CORD FOR DATA REQUIREMENTS.

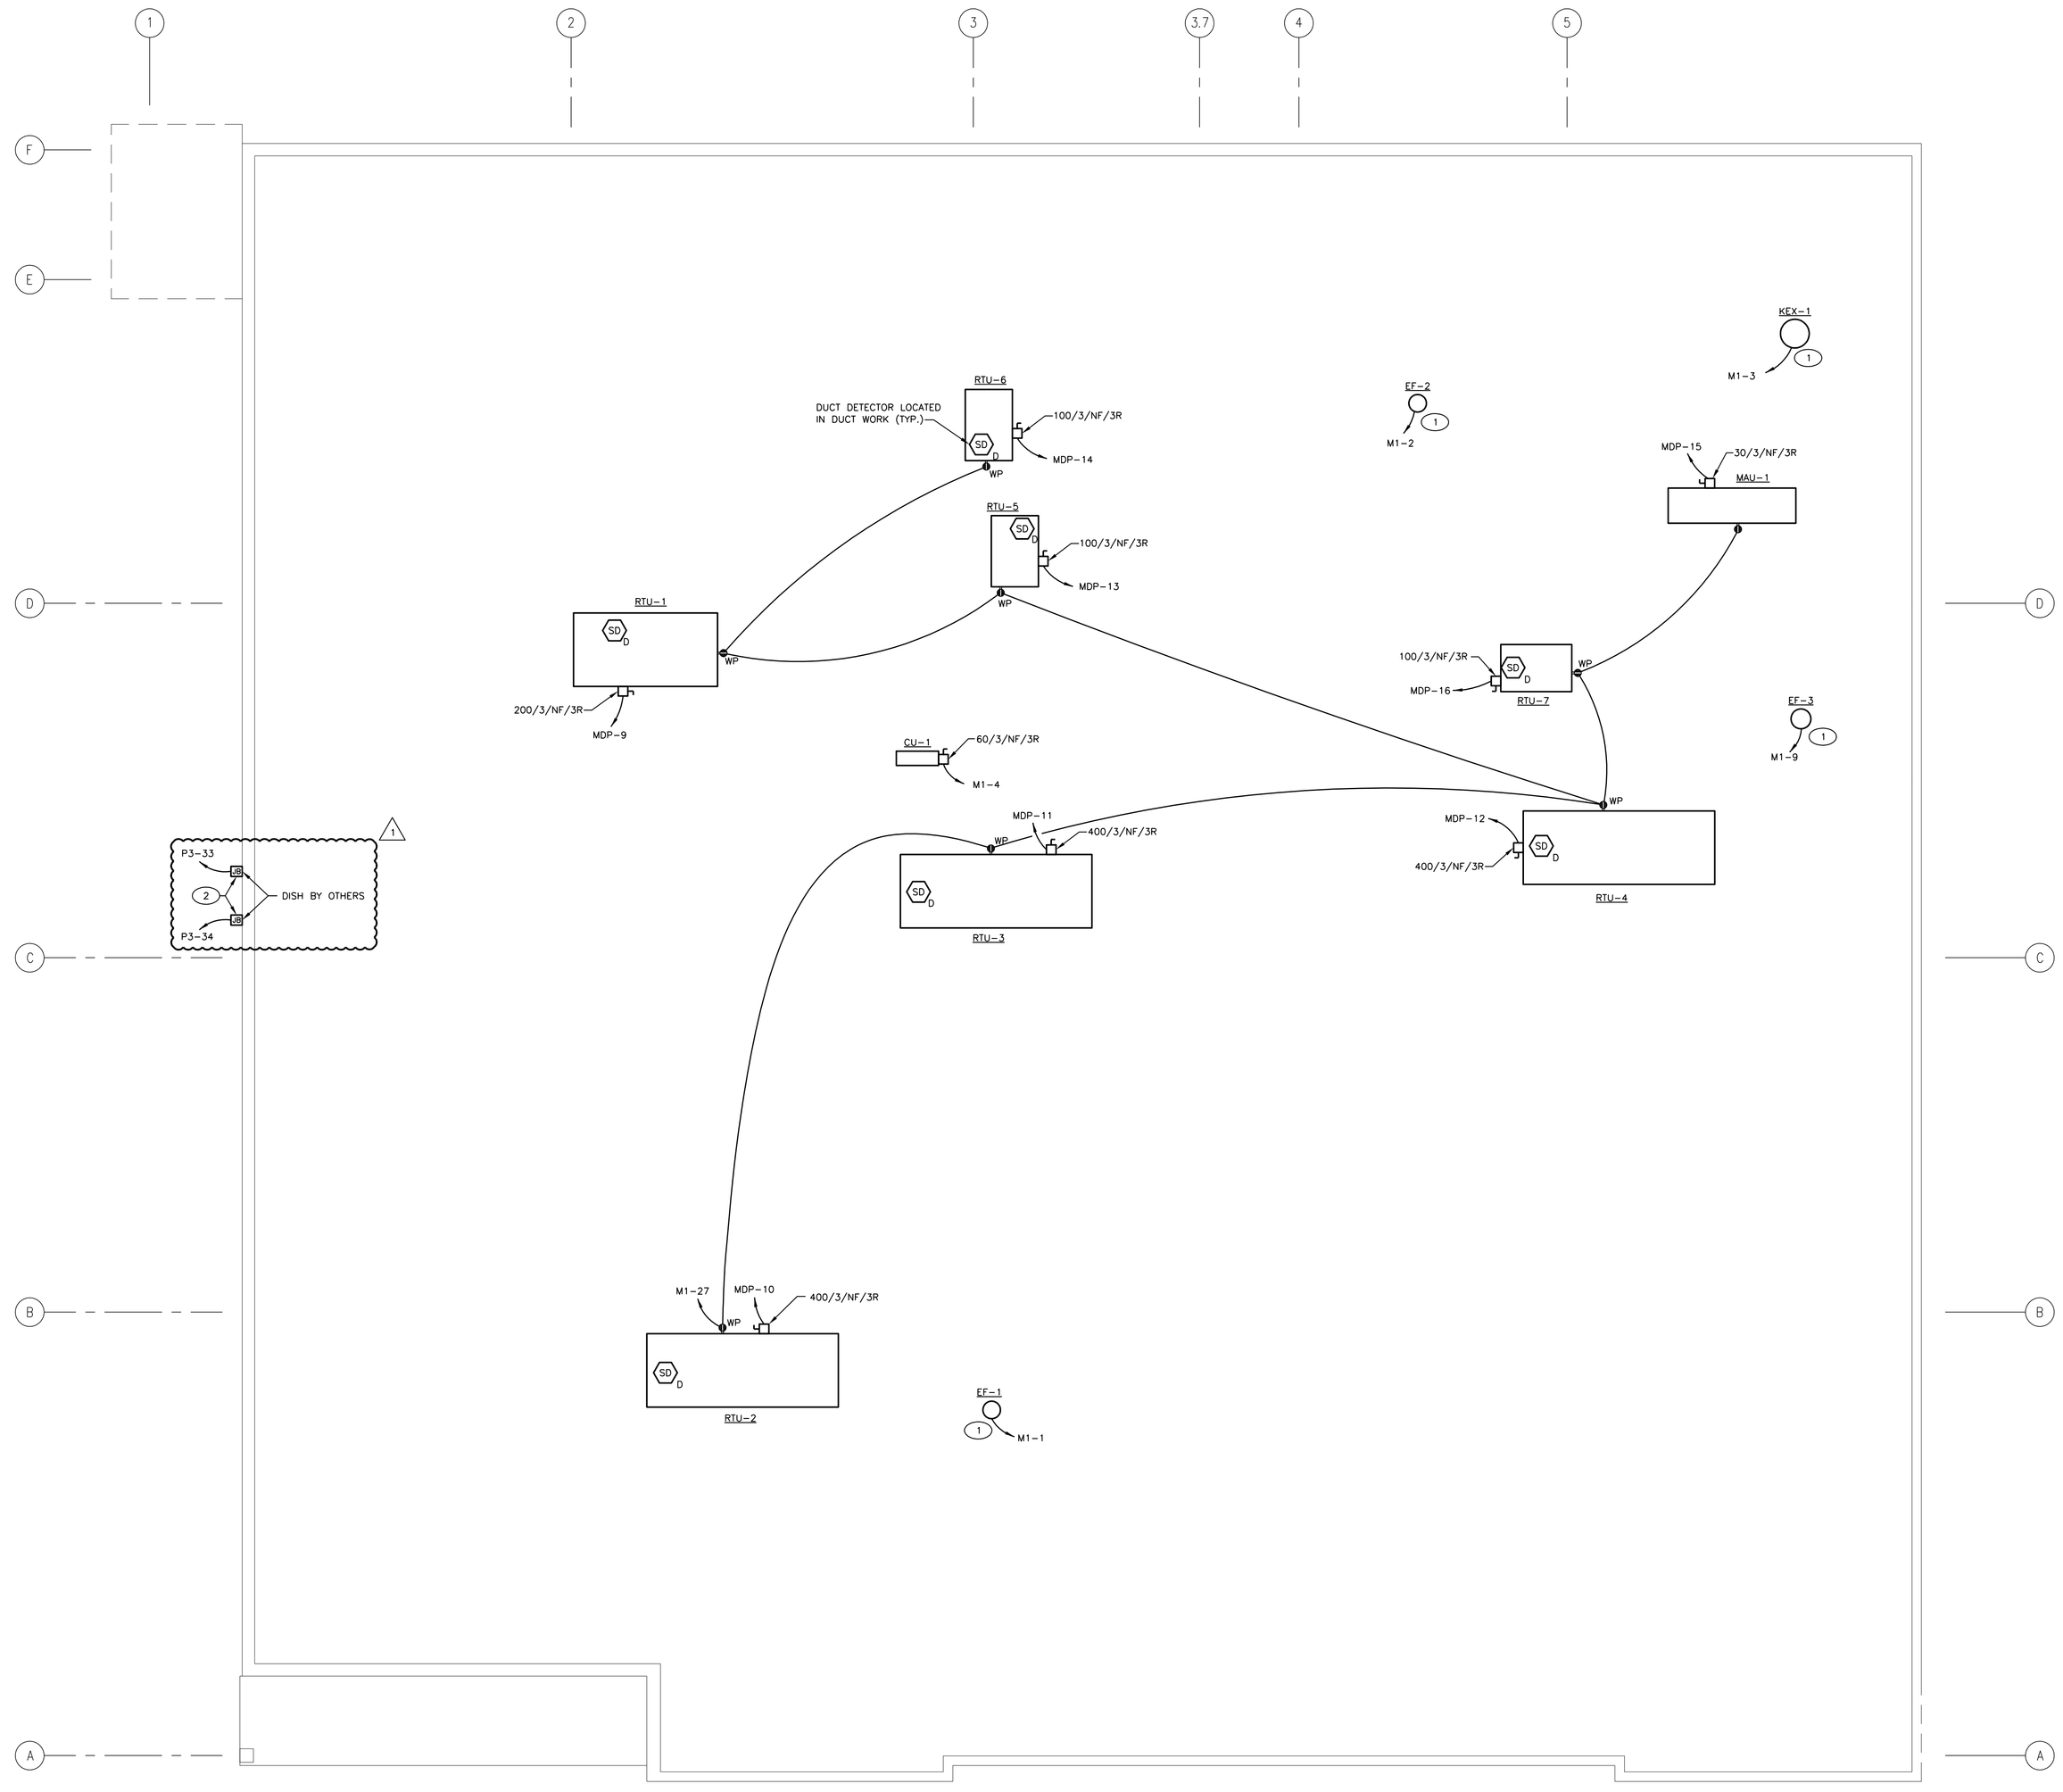

ELECTRICAL ROOF PLAN

SCALE: 1/8"=1'-0"

SEAL

OWNER

CONSULTANT

CONSULTANT

BARRY ISETT & ASSOCIATES, INC.
Consulting Engineers & Surveyors
P.O. Box 147
Trevorton, PA 18087-0147
610 - 398 - 0904 www.barryisett.com

ARCHITECT

ARCHITECTURAL CONCEPTS LLP
Architecture • Planning • Interiors • Engineering
The Gilmeret Mansion at Oaklands Corporate Center
626 West Lincoln Highway • Exton, Pennsylvania 19341
Phone: (610) 518-1596 • Fax: (610) 873-1587
Email: arconcepts@arconcepts.com
www.arconcepts.com
Theodore A. Mondzelewski Jr., AIA
Bruce D. Weinsteiger, AIA
James L. Cherry III, AIA

PROJECT

THE FAVORITES AT TOMS RIVER

BANANIER DRIVE
DOVER TOWNSHIP
OCEAN COUNTY
TOMS RIVER, NJ 08755

REVISIONS

No.	Date	Revision
	09-22-06	ISSUED FOR BIDDING
	05-04-07	ISSUED FOR RE-BIDDING
	06-01-07	ISSUED FOR RE-BIDDING
1	09-21-07	ISSUED FOR CONSTRUCTION

Sheet Title:
ELECTRICAL ROOF PLAN

Issue Phase: **RE-ISSUED FOR BIDDING**
Issue Date: **30 APRIL 2007**
Drawing Scale: **AS NOTED**
Drawing Path: **P:\06-020 Tom's River Turf Club**
Drawn By: **DMR** | Reviewed By: **JRD/DRP**
Project Number: **114306**
File Name:
Plot Scale:
Paper Size: **30" X 42"**
Drawing No. **E2.4**
Sheet **06** of **12**